


LEVEL
24.01.2010
14:54:29

Output: Analog
Imp: <150hm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp:100kOhm

Filter:
Off

B: 9.48dBV 250.7 Hz

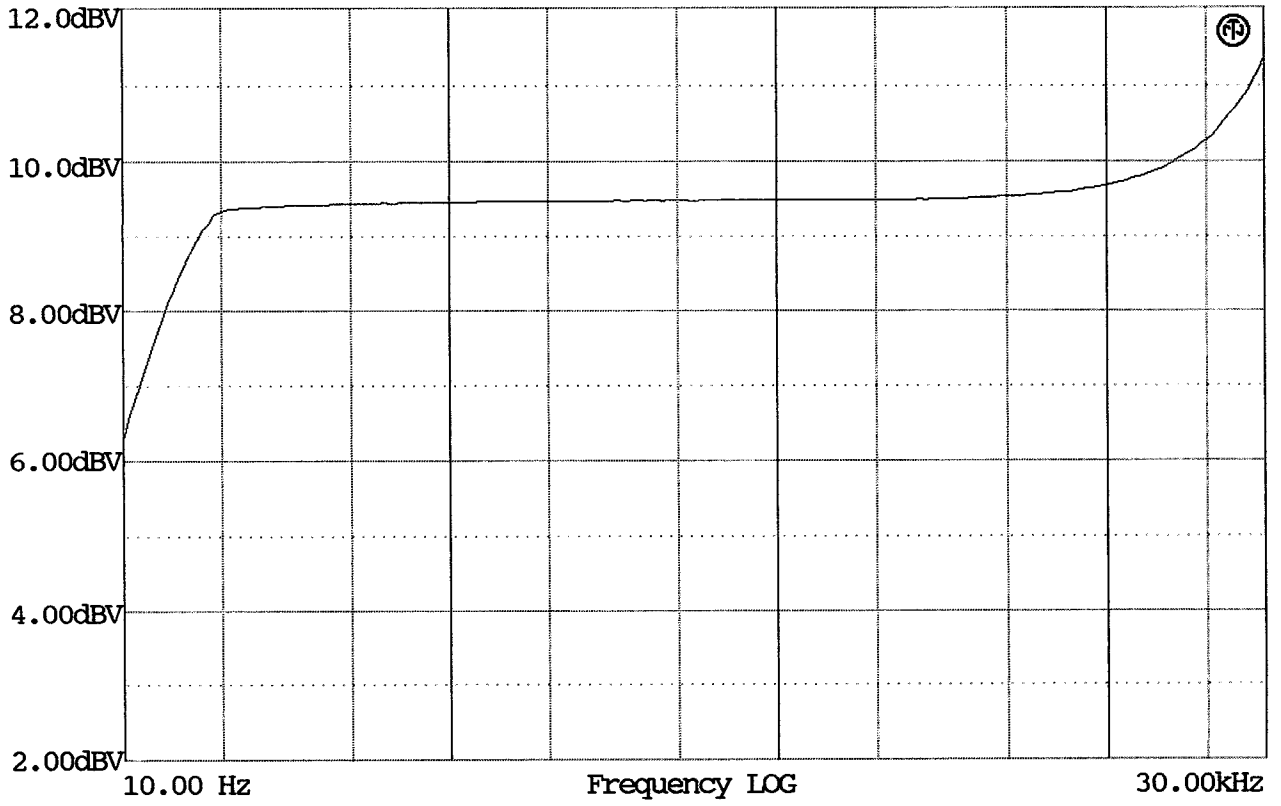


THD+N
24.01.2010
15:00:04

Output: Analog
Imp: <150hm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp:100kOhm

Filter:
Off

B: 9.48dBV 250.7 Hz

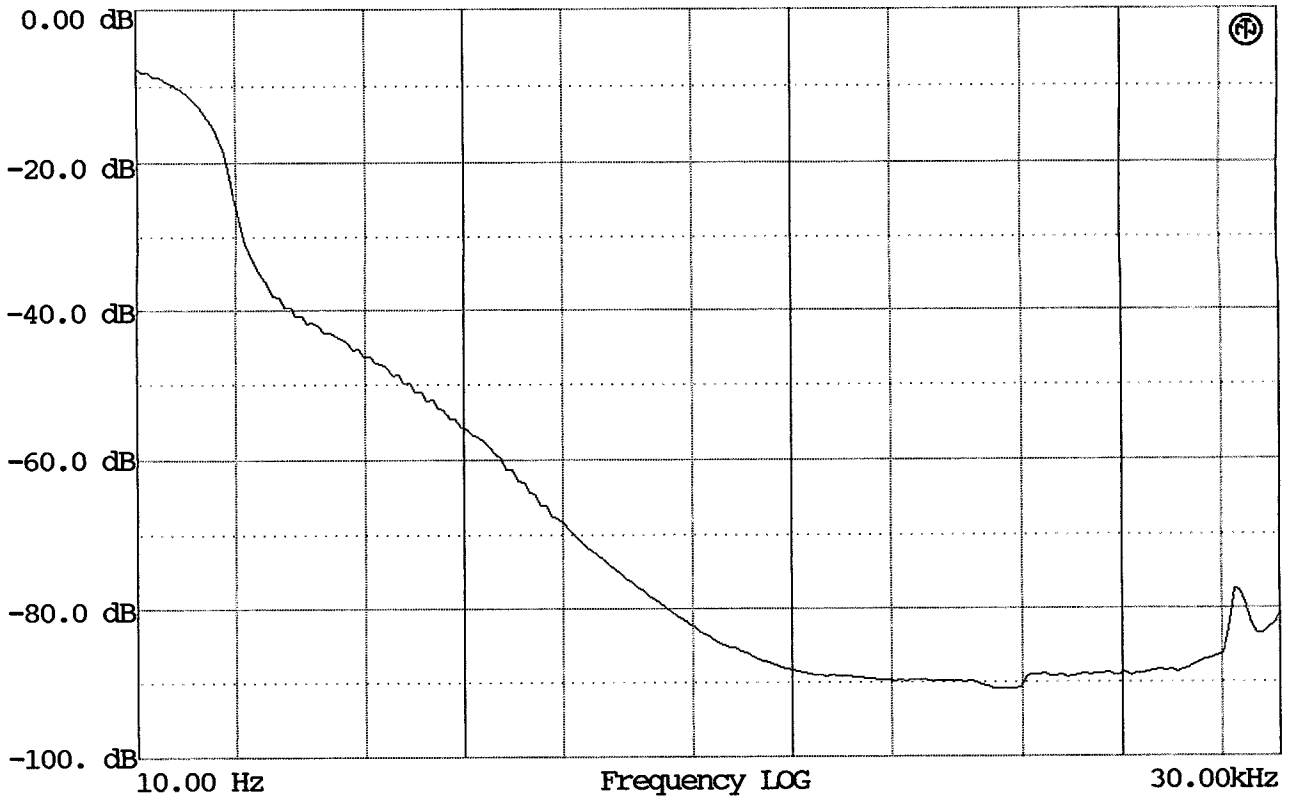

3AN 670 05


LEVEL
24.01.2010
15:42:01

Output: Analog
Imp: <150hm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp:100kOhm

Filter:
Off

B: 7.89dBV 250.7 Hz

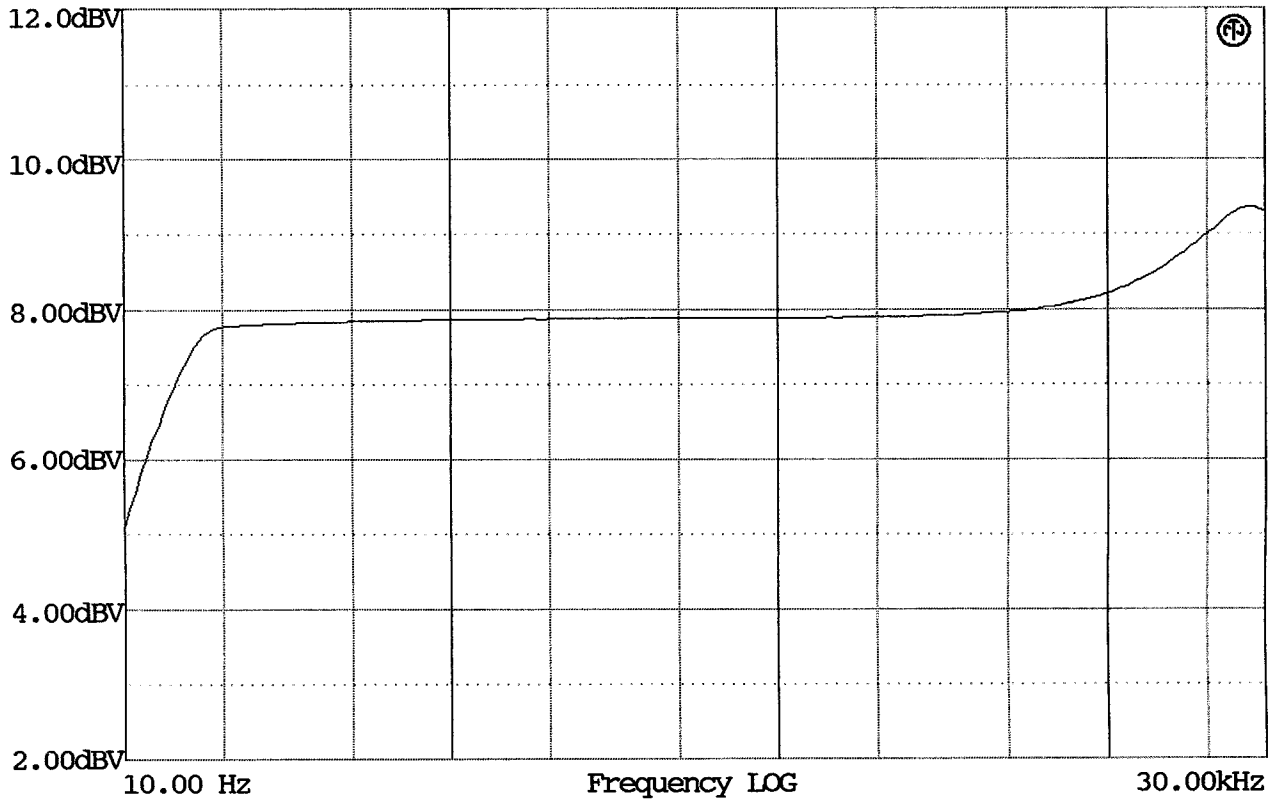


THD+N
24.01.2010
15:47:40

Output: Analog
Imp: <150hm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp:100kOhm

Filter:
Off

B: 7.89dBV 250.7 Hz

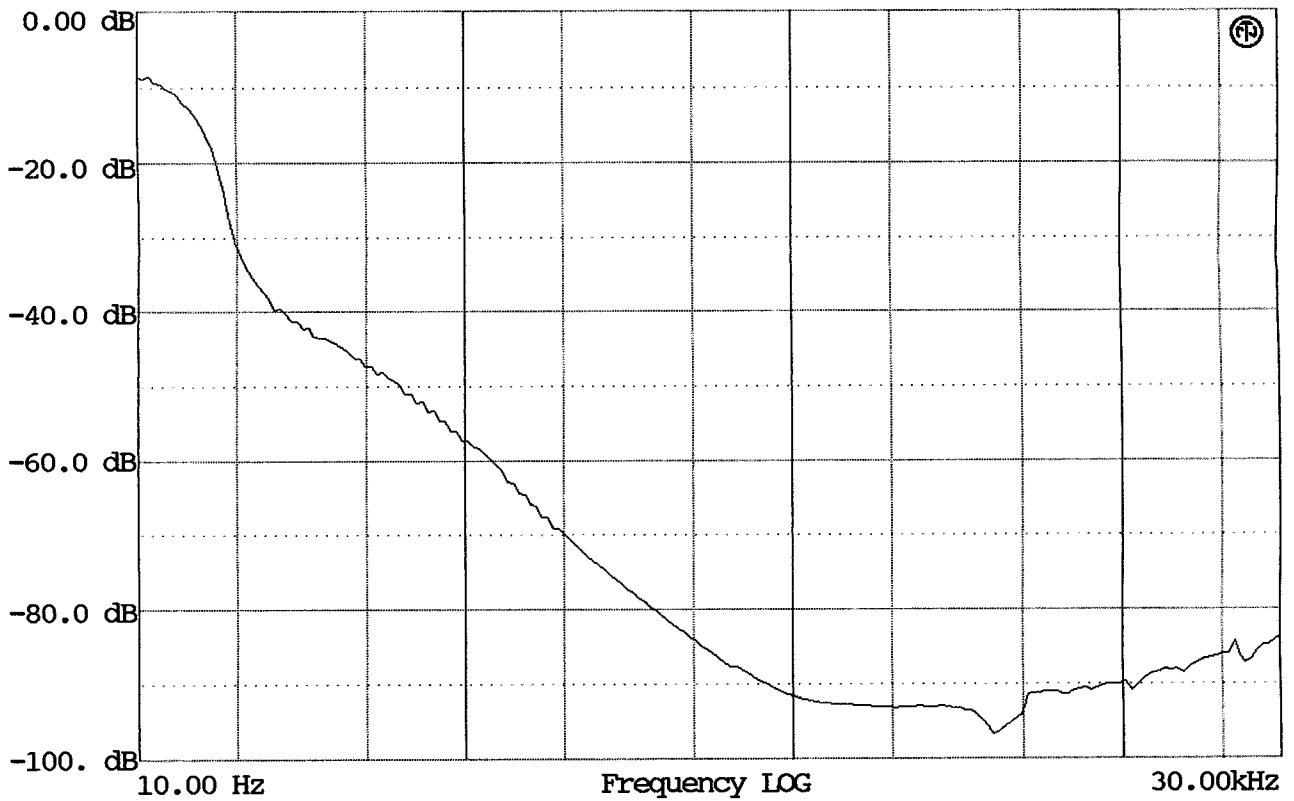

3kV 670 05 + 4k7 11nF


LEVEL
24.01.2010
15:01:46

Output: Analog
Imp: 200Ohm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: 9.21dBV 250.7 Hz

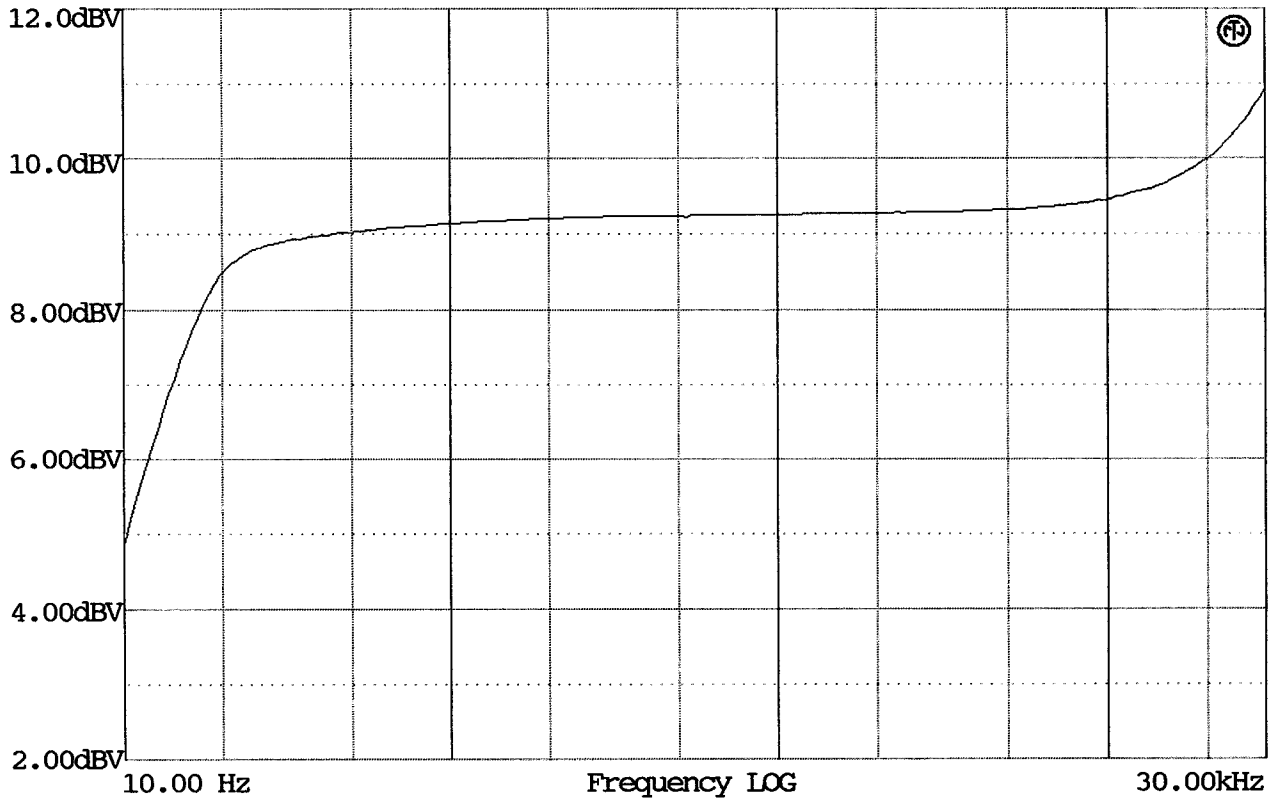


THD+N
24.01.2010
15:12:36

Output: Analog
Imp: 200Ohm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: 9.21dBV 250.7 Hz

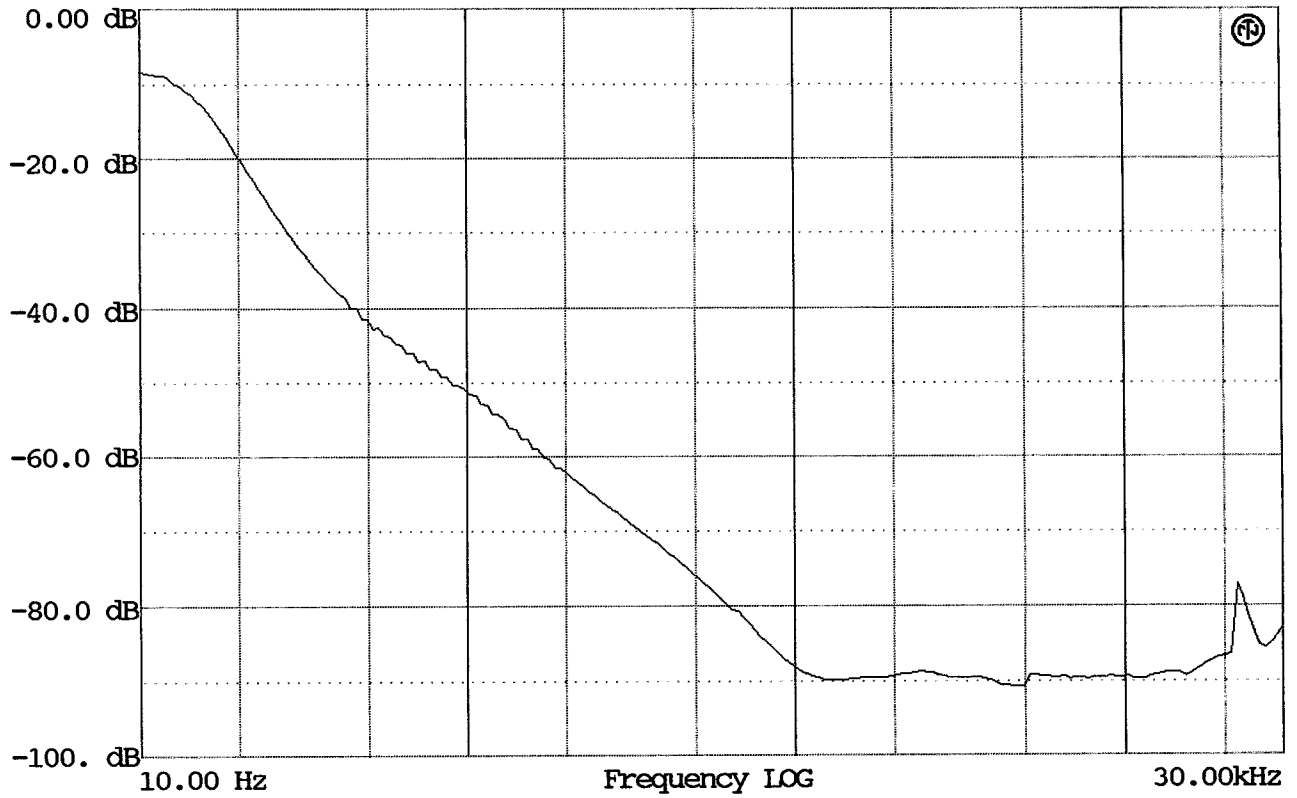

3AN 670 05


LEVEL
24.01.2010
15:25:29

Output: Analog
Imp: 200Ohm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: 5.59dBV 250.7 Hz

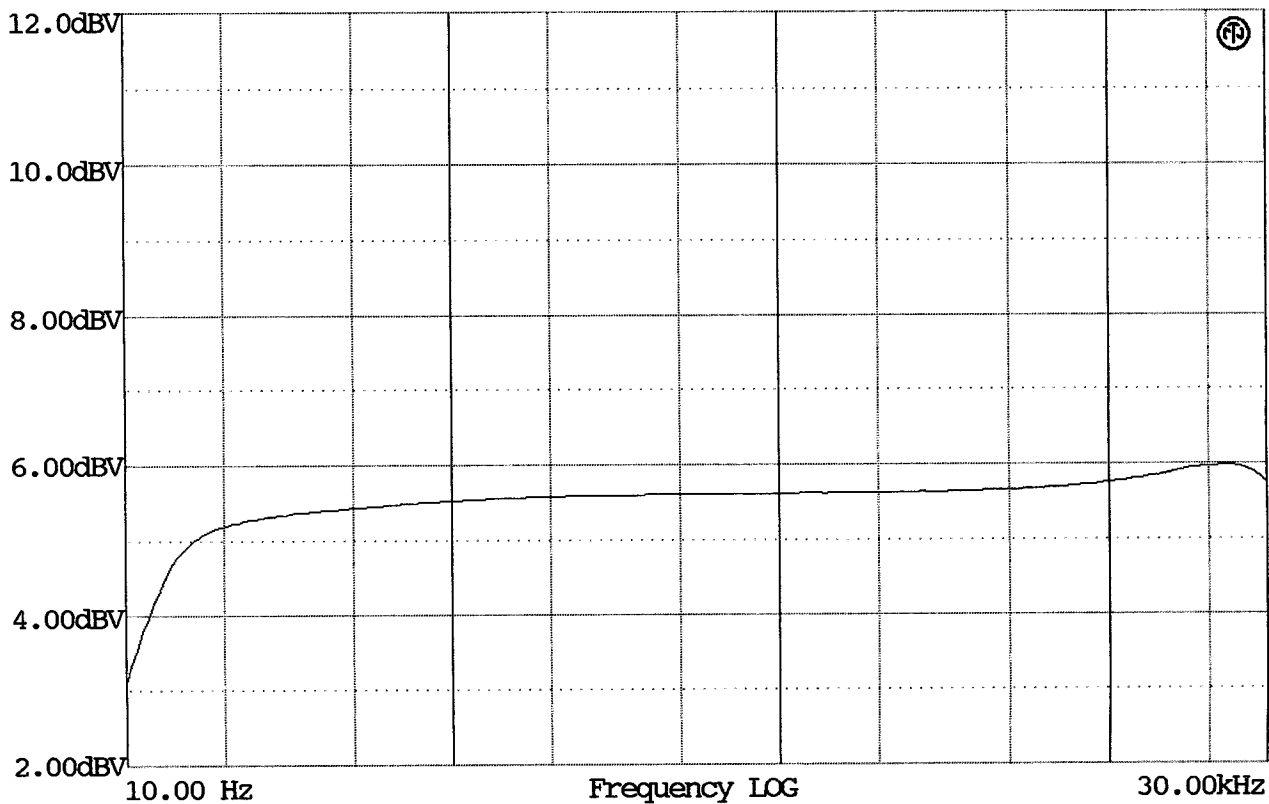


THD+N
24.01.2010
15:30:57

Output: Analog
Imp: 200Ohm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: 5.59dBV 250.6 Hz

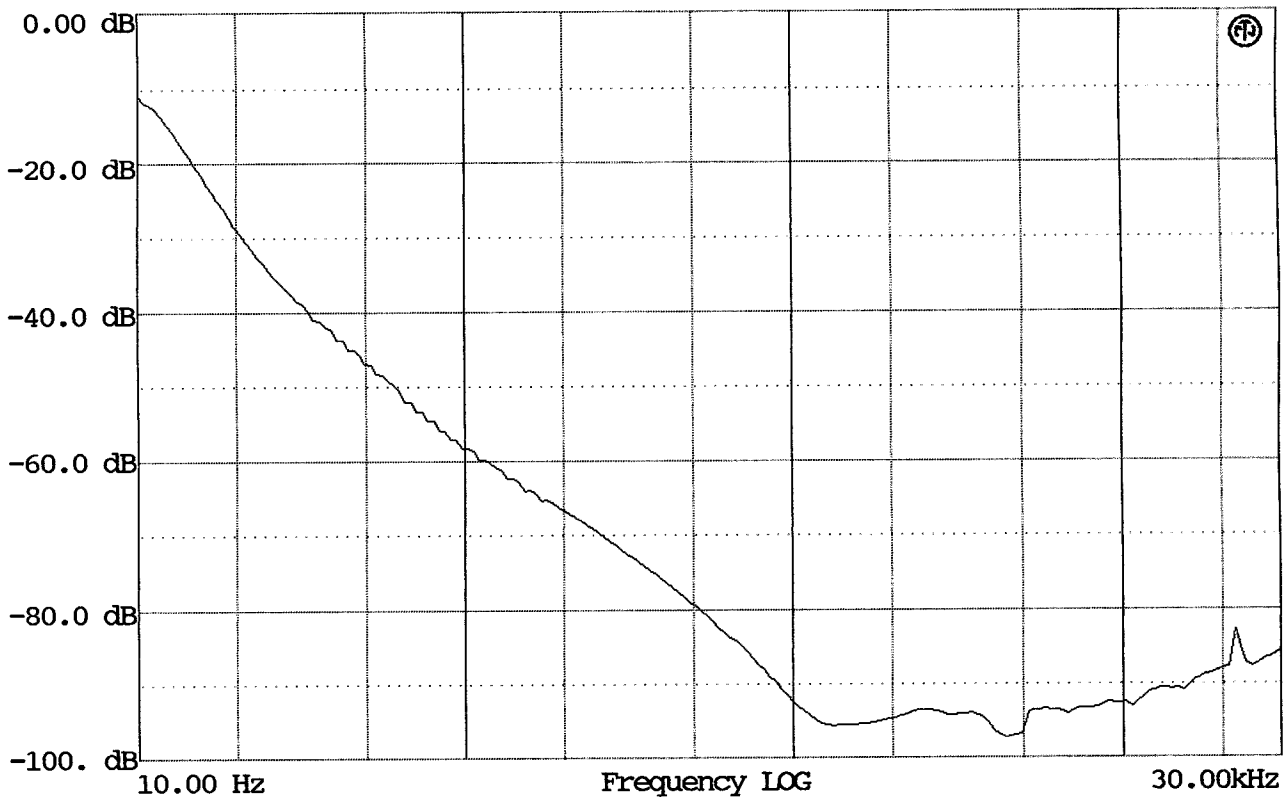

3AN670 05 + 467 11 nF


LEVEL
24.01.2010
15:14:57

Output: Analog
Imp: 600Ohm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: 8.69dBV 250.7 Hz

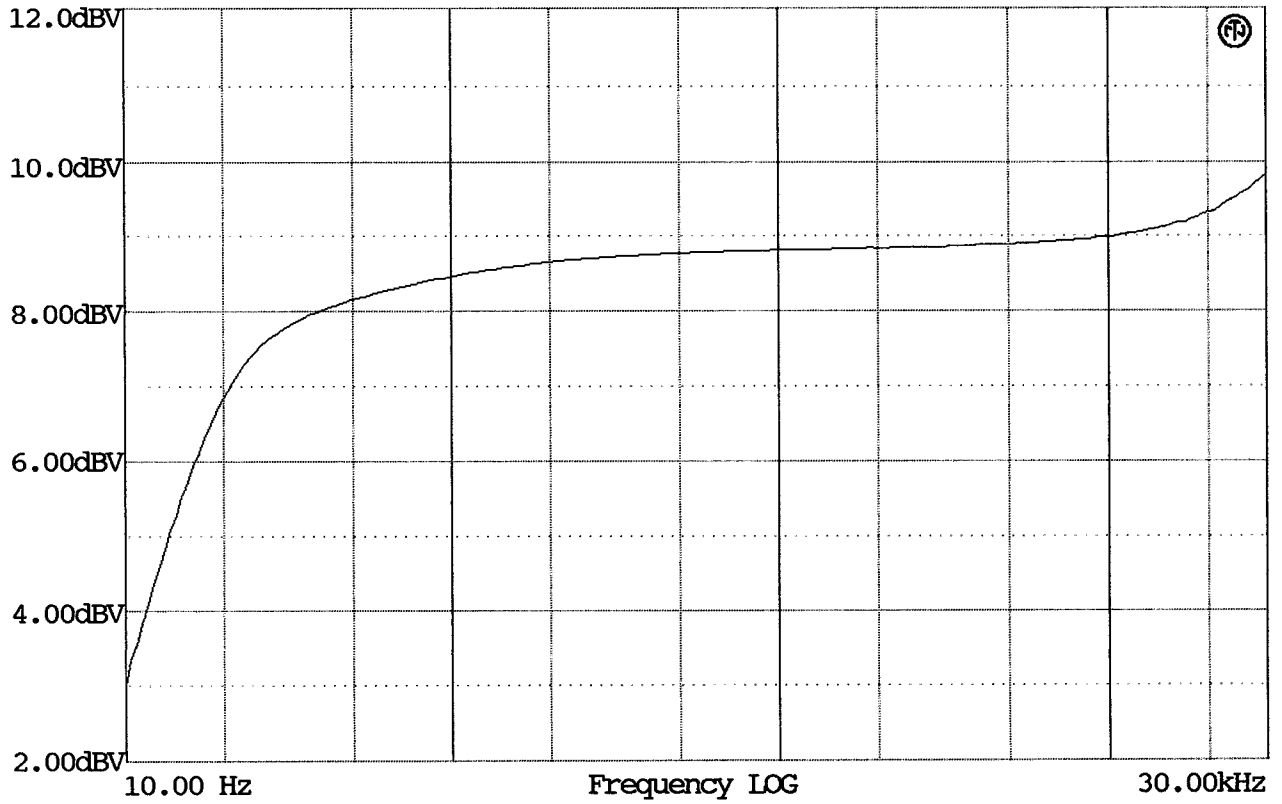


THD+N
24.01.2010
15:20:31

Output: Analog
Imp: 600Ohm
Sine
-0.01dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: 8.68dBV 250.7 Hz

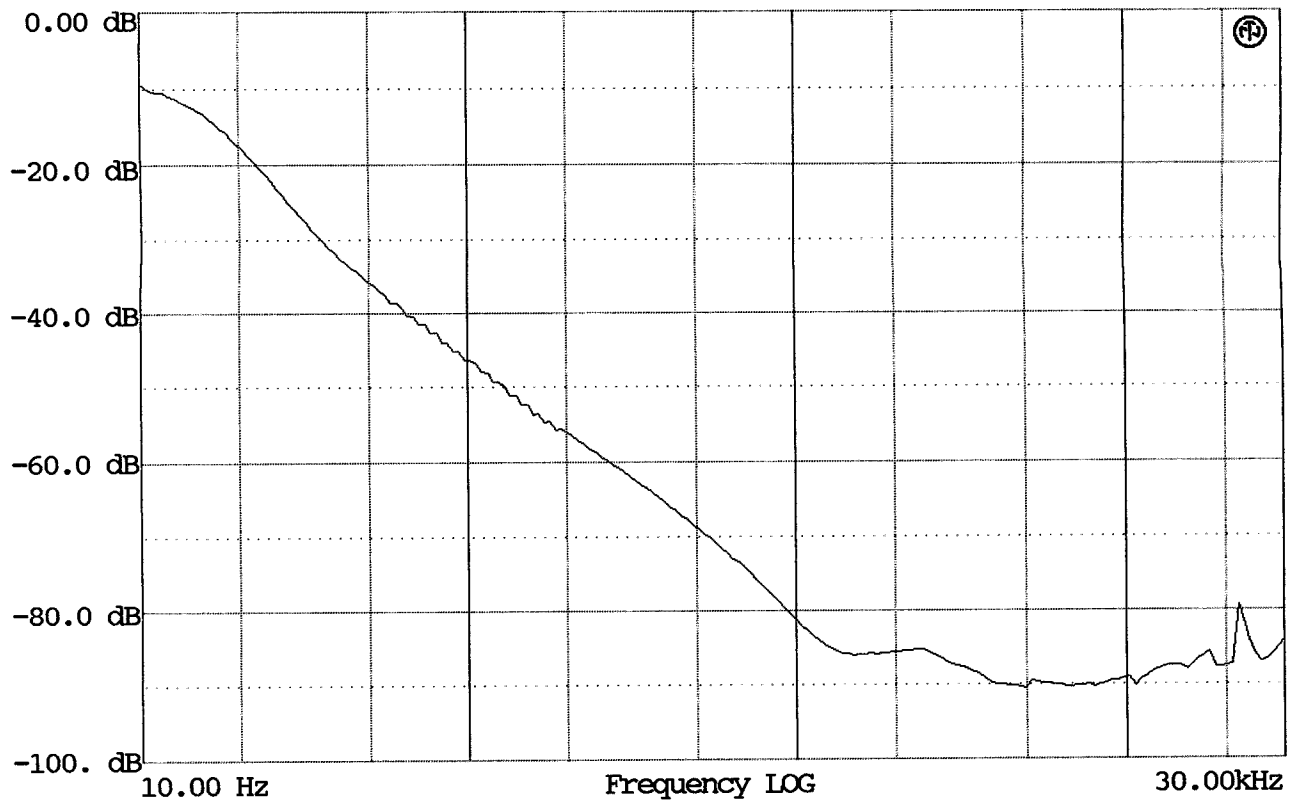

JAN 670 05


THD+N
24.01.2010
16:46:56

Output: Analog
Imp: 200Ohm
Sine
-10.0dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: -0.76dBV 250.7 Hz

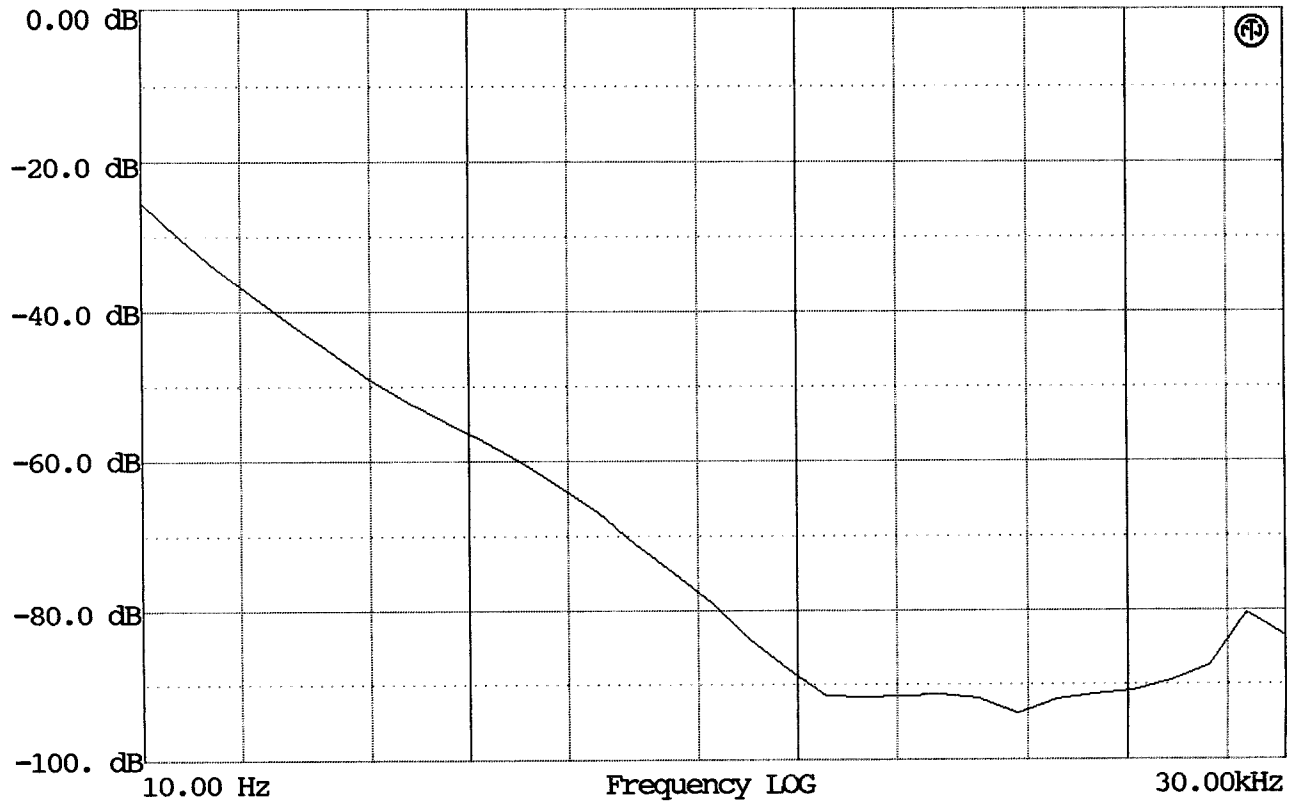


THD+N
24.01.2010
19:23:08

Output: Analog
Imp: 200Ohm
Sine
-20.0dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: -10.7dBV 250.7 Hz

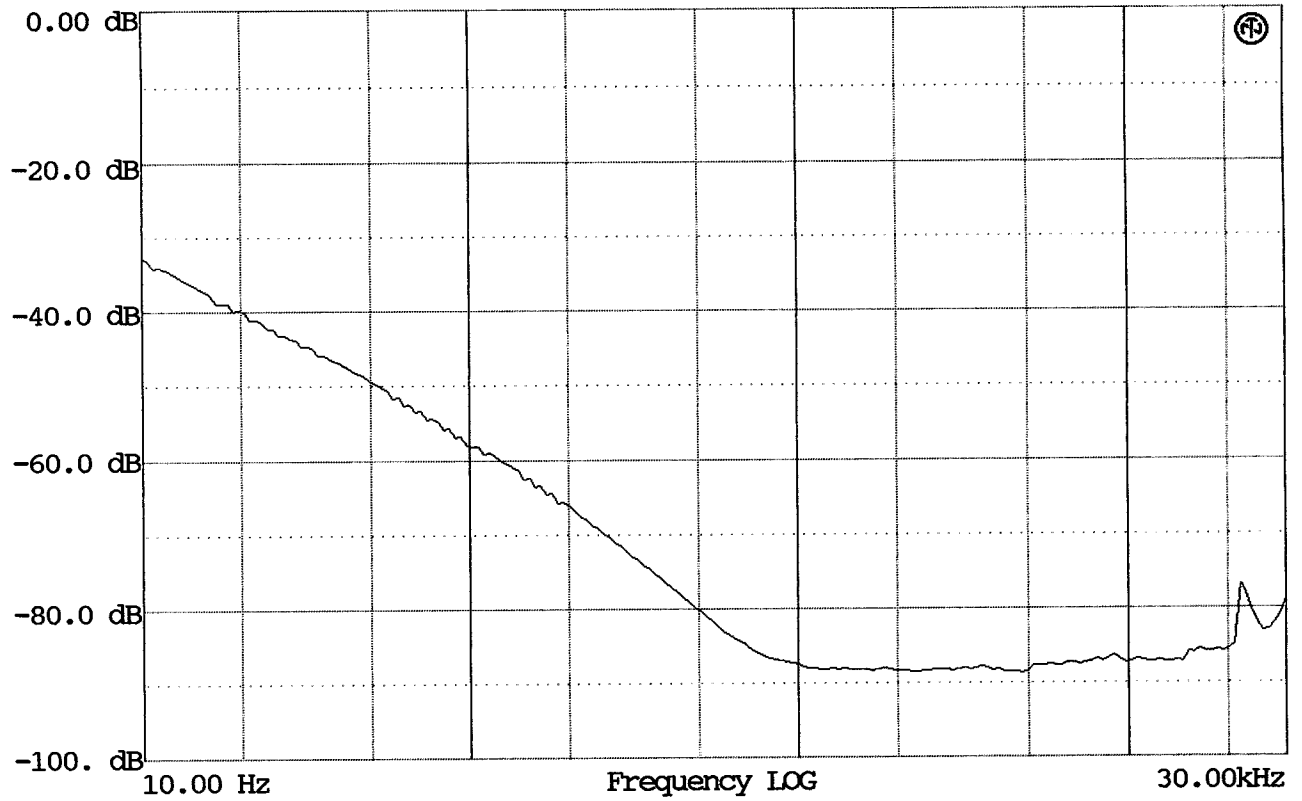

3AN 670 05


THD+N
24.01.2010
16:02:03

Output: Analog
Imp: 200Ohm
Sine
-10.0dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: -4.42dBV 250.7 Hz

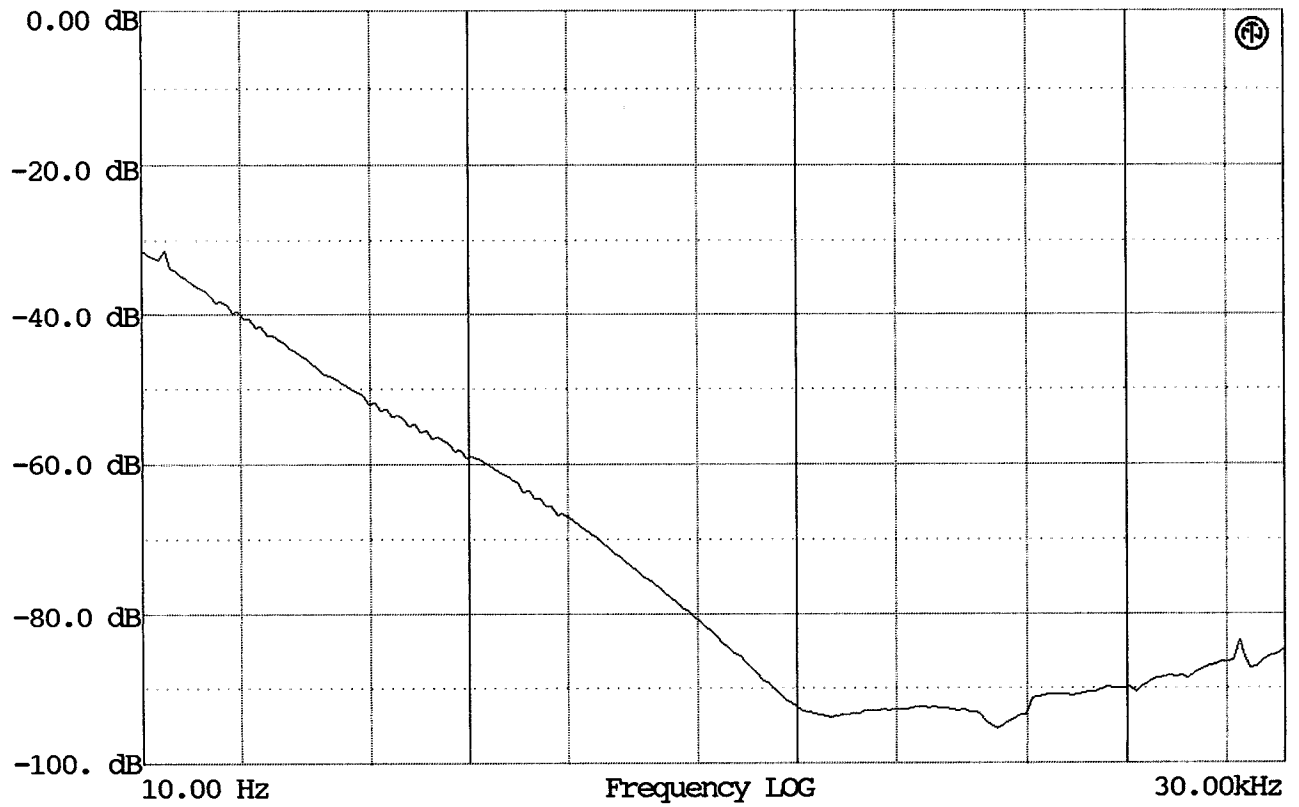


THD+N
24.01.2010
16:07:43

Output: Analog
Imp: 200Ohm
Sine
-20.0dBV 250.7 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

B: -14.4dBV 250.7 Hz

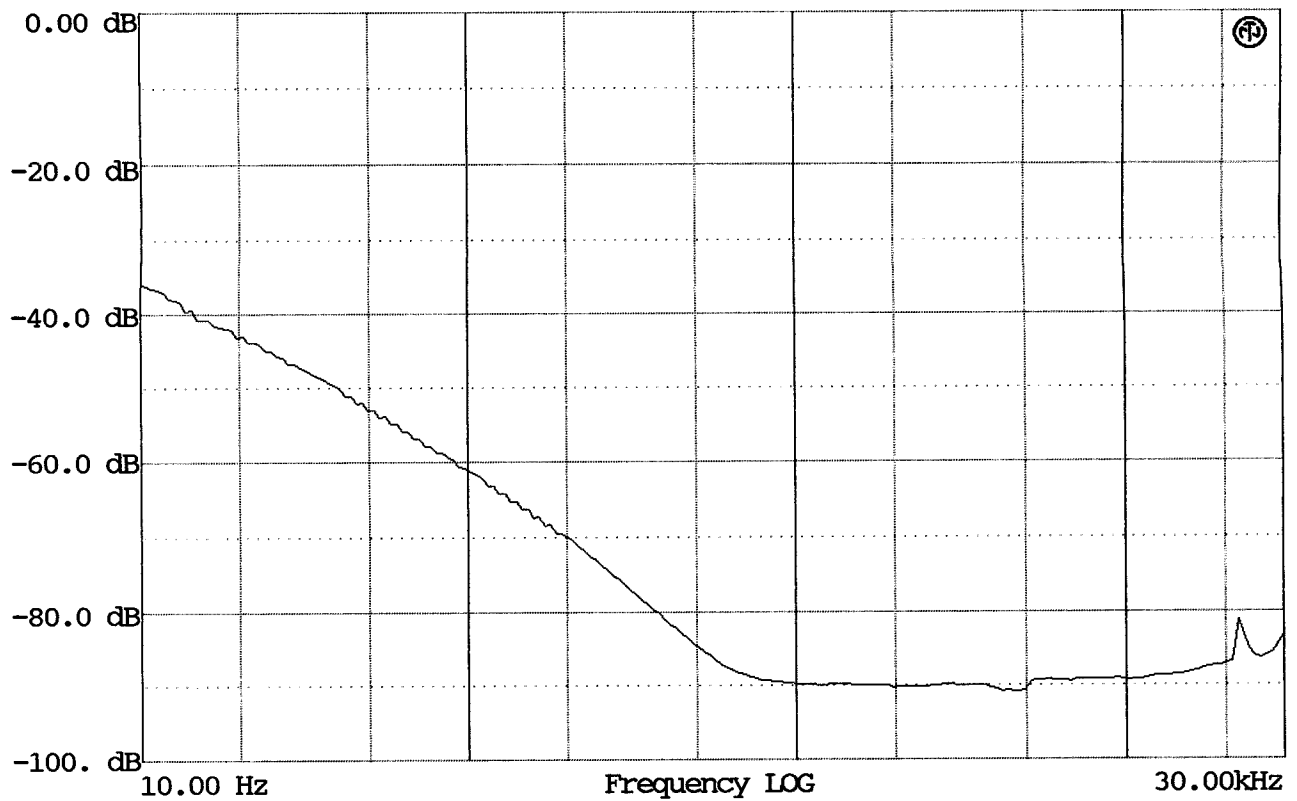

3kV67005 + 46711nF