


LEVEL
19.10.2009
12:29:01

Output: Analog
Imp: 600Ohm
Sine
0.00dBV 250.0 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

A: -0.38dBV 249.9 Hz

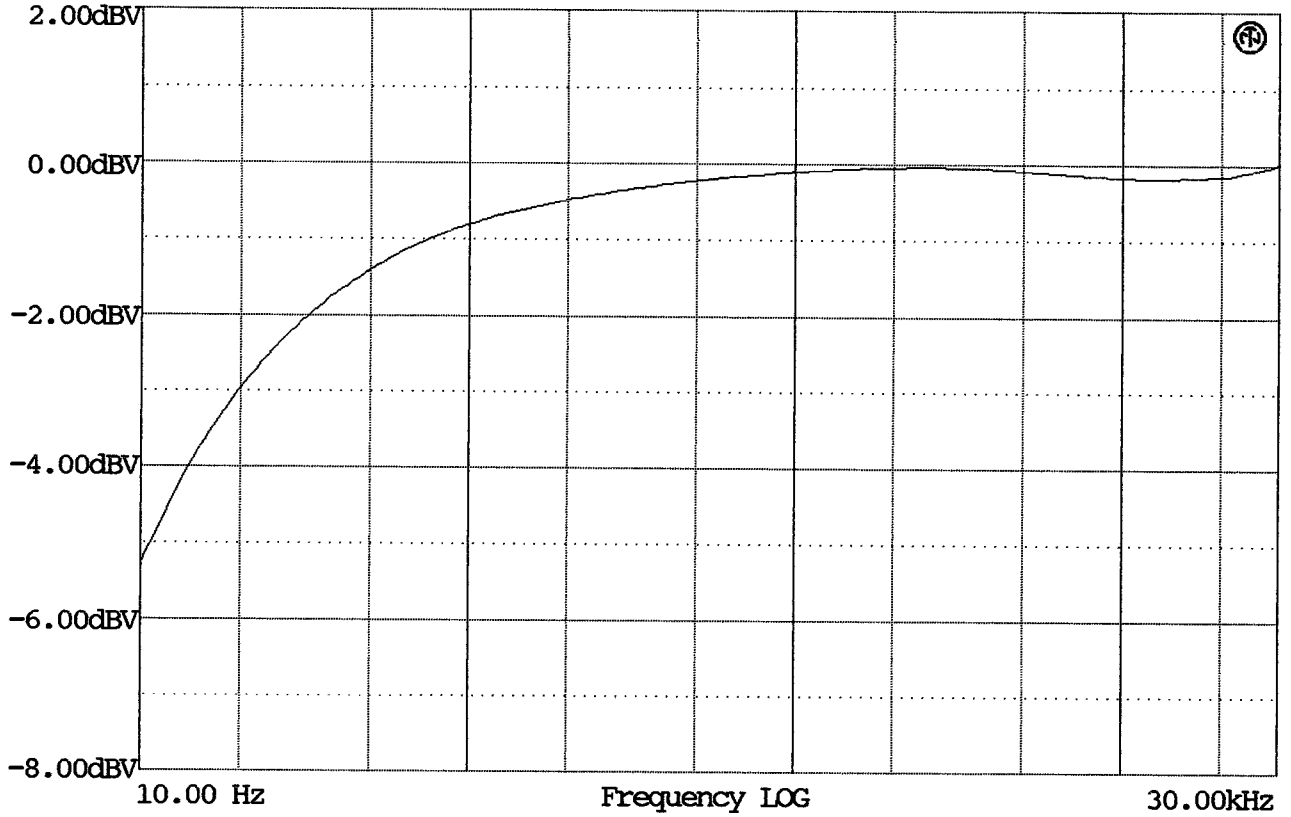


THD+N
19.10.2009
13:09:55

Output: Analog
Imp: 600Ohm
Sine
0.00dBV 250.0 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

A: -0.38dBV 249.9 Hz

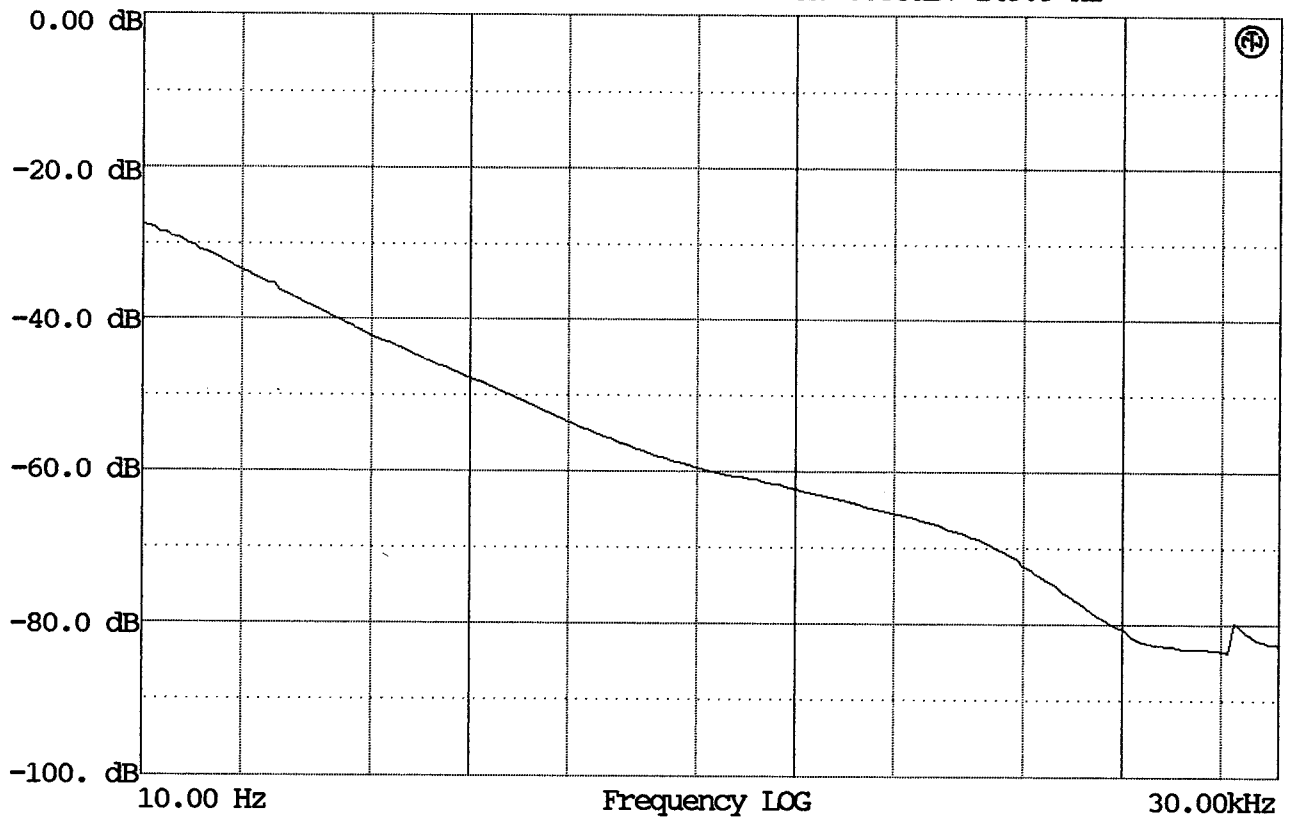


THD+N
19.10.2009
13:15:45

Output: Analog
Imp: 600Ohm
Sine
10.0dBV 250.0 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

A: 9.66dBV 249.9 Hz

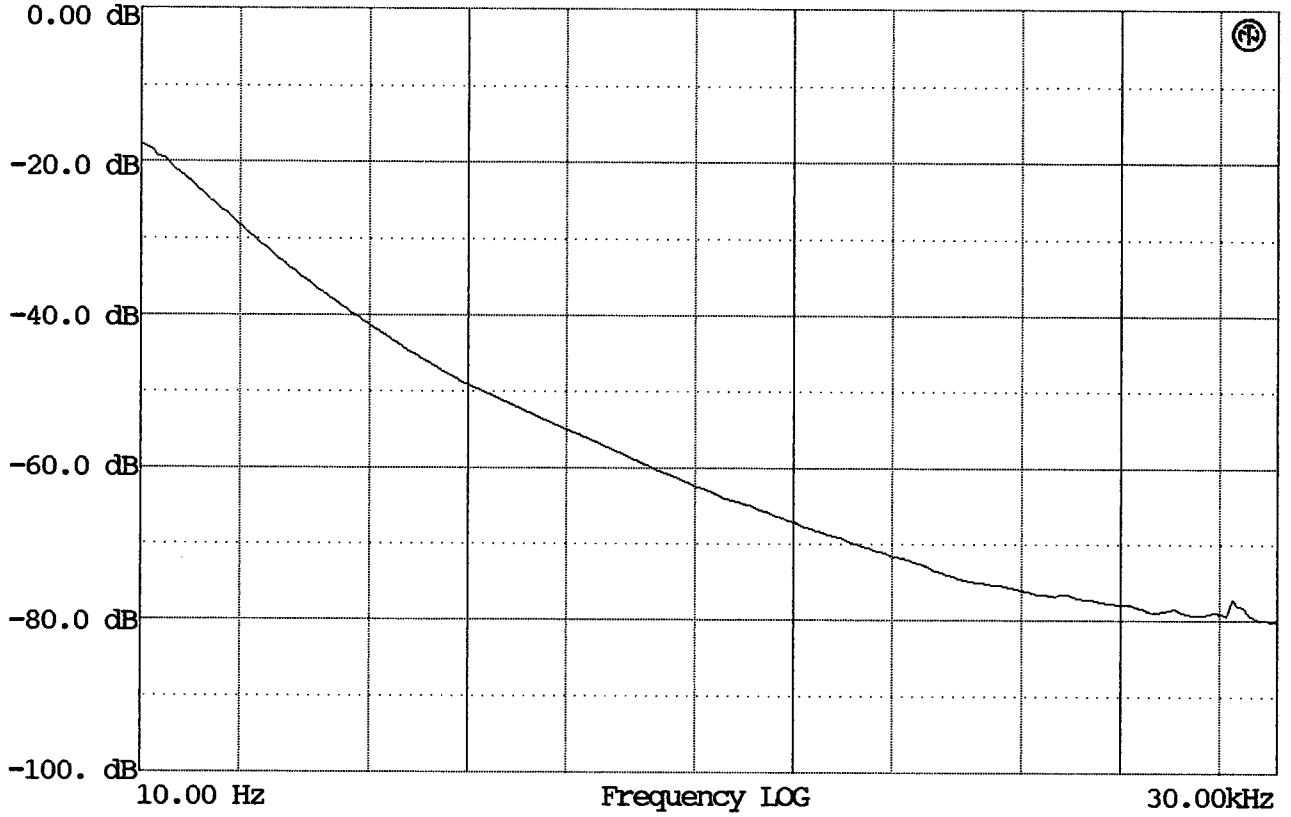


THD+N
19.10.2009
13:30:03

Output: Analog
Imp: 600Ohm
Sine
20.0dBV 250.0 Hz

Input: Analog
Imp: 100kOhm

Filter:
Off

A: 19.7dBV 249.9 Hz

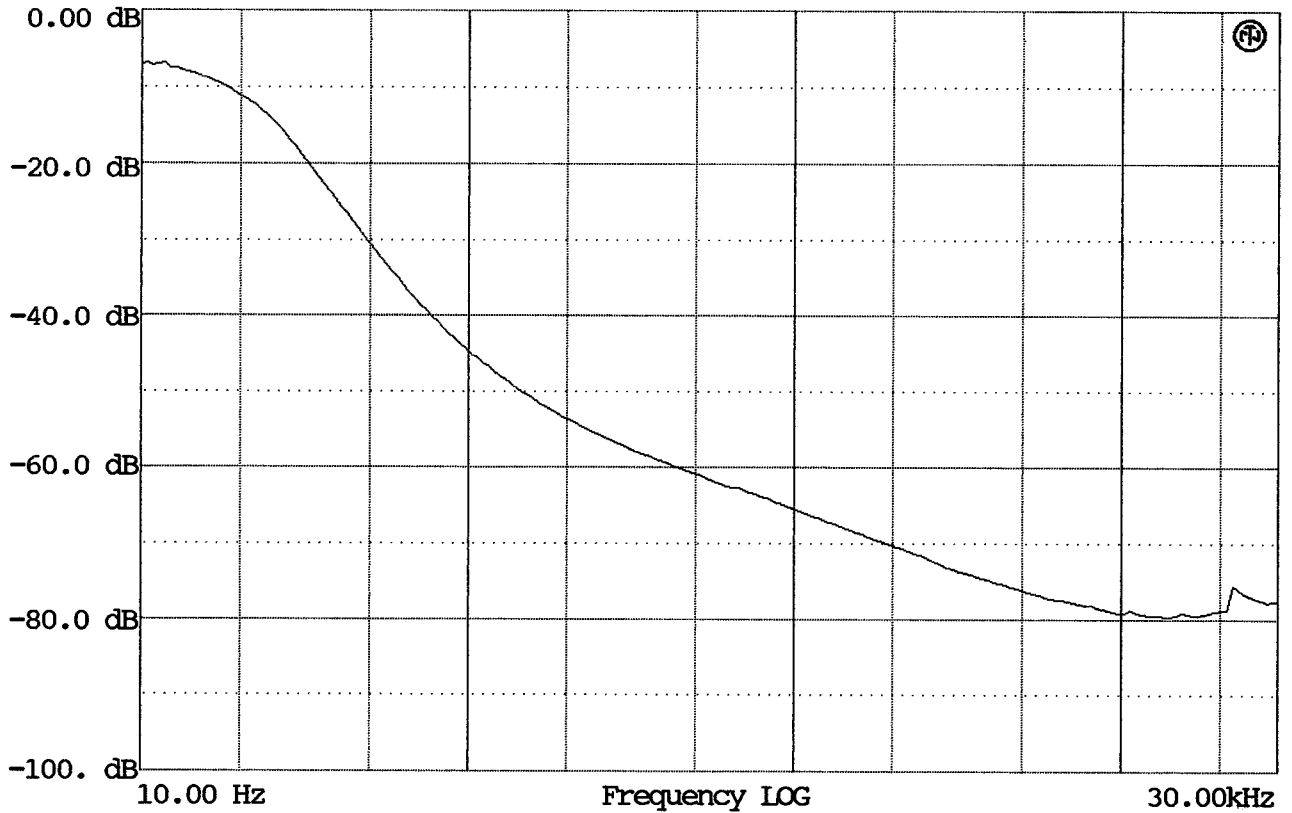


THD+N
19.10.2009
13:44:31

Output: Analog
Imp: 600Ohm
Sine
-10.0dBV 250.0 Hz

Input: Analog
Imp: 100kOhm

Filter:
AUDIOBP

A: -10.4dBV 249.9 Hz

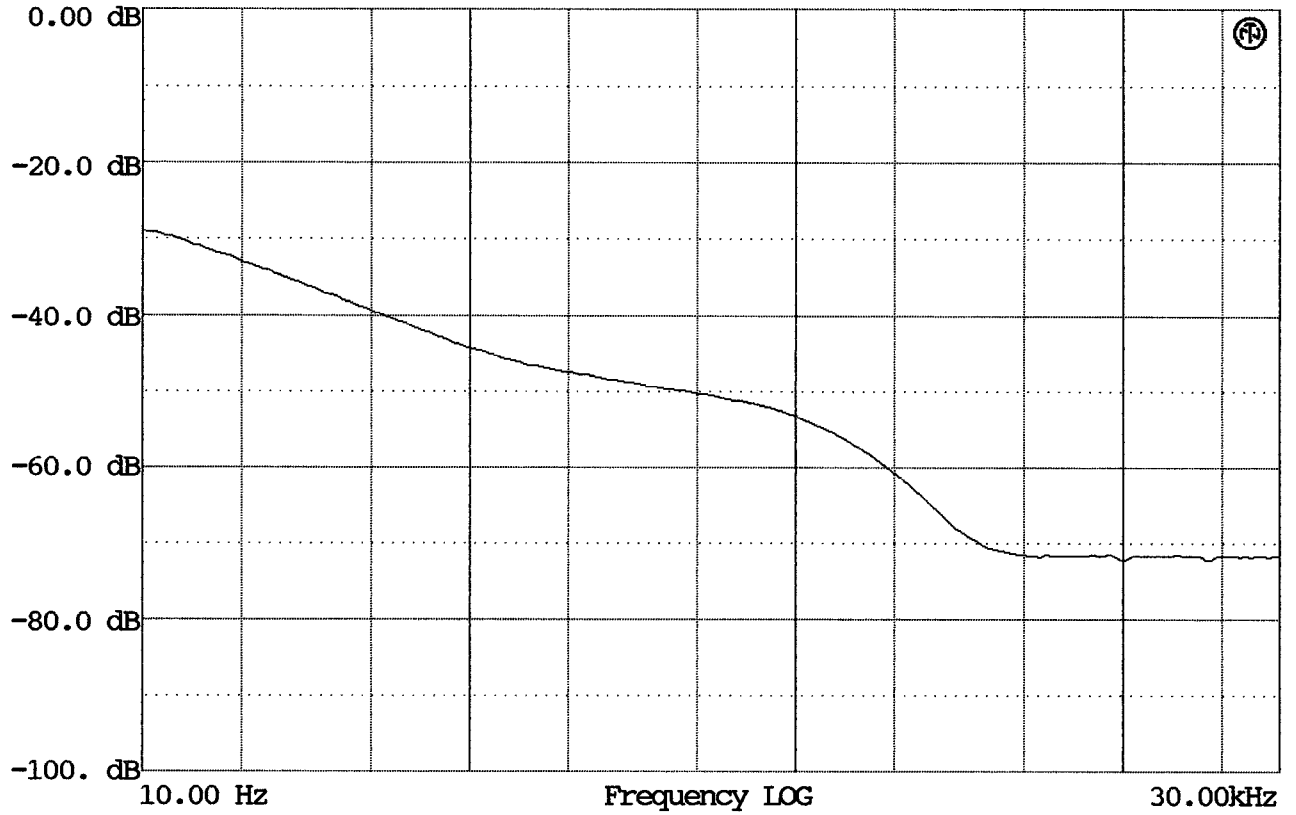


THD+N
19.10.2009
13:59:58

Output: Analog
Imp: 600Ohm
Sine
-20.0dBV 250.0 Hz

Input: Analog
Imp: 100kOhm

Filter:
AUDIOBP

A: -20.8dBV 249.9 Hz

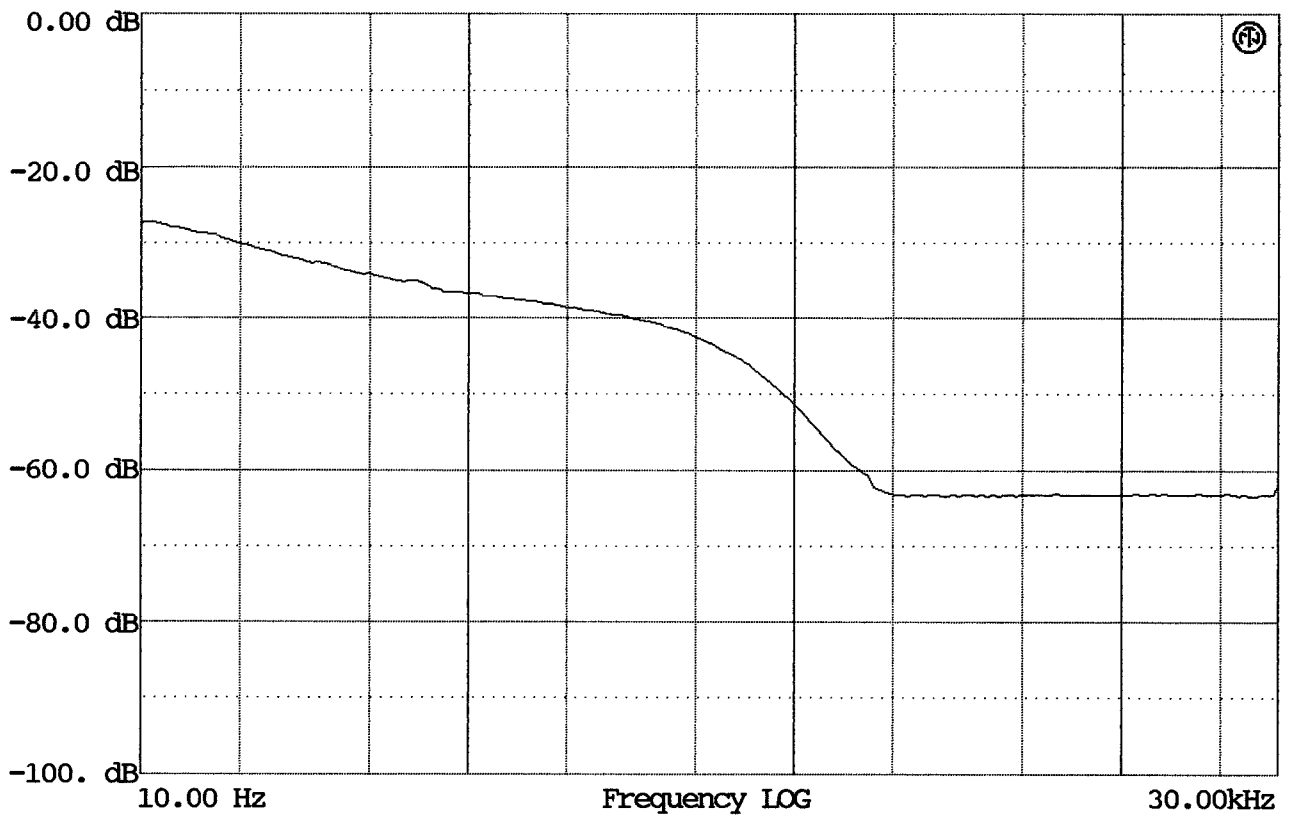

BELTINGER 07-1